

Original Research Article

Assessment and Control of Sulfate Reducing Bacteria and Scales Formation in Sea Water used in Cooling Systems of Abu-Qir and Ataka Power Stations

A. B. Ramadan[†], M. F. Ghaly[‡], A. A. Hammad³, M.R. El- Shahawy[†] and M. M. Abdelrahman^{*†}

[†]Sitting & Environmental Department, Egyptian Nuclear and Radiological Regulatory Authority (ENRRA), Nasr City, Cairo, Egypt

[‡]Department of Botany and Microbiology, Faculty of Science, Zagazig University, Zagazig, Egypt

[†]Microbiology Department, National Centre for Radiation Research and Technology, Nasr City, Cairo, Egypt.

Received 10 Jan 2015, Accepted 15 Feb 2015, Available online 01 March 2015, Vol.4 (2015)

Abstract

Microbial biofilm and corrosion in cooling systems either in power stations or in nuclear power plants are most common problems and causing expensive equipment's damage, loss of production and increase maintenance costs. Among anaerobic bacteria, sulphate reducing bacteria (SRB) are most often blamed because it was considered the major bacterial group involved in microbiologically influenced corrosion (MIC). We investigated how to control it chemically and also controlling the scales formed accompanying it in the closed cooling systems in two different power stations: Abu-Qir (Alexandria) station established on Mediterranean Sea and Ataka (Suez) station established on Gulf (Suez). Different categories of biocides Champion (A, B), E.C.C. (A, B) and E.P.R.I. (A, B) were used for controlling SRB growth chemically in cooling water samples. It was found that 500 ppm of Champion biocide type A was enough to make log bacterial count equal to zero recording efficiency 100%, whereas, 600 ppm from Champion type B was needed to reach the same result. For biocide E.C.C. (A, B), 600 ppm are enough for eliminate SRB log count. Also, for the biocide E.P.R.I. type A, 600 ppm was effective 100% whereas type B its efficiency reached 68.42% with the same concentration. The results indicated that Champion biocide - A type - was the most effective biocide of all investigated types for controlling SRB in the Abu-Qir and Ataka water samples. The results shows also that as the concentration of biocide increased, SRB growth decreased in presence or absence of the scales inhibitor but in the presence of the scales inhibitor Gypton SA860N, the efficiency of the two biocides decreased by small interval values. Three types of scales inhibitors were used in this work with commercial names Gypton SA860N, Gypton SD132 and Gypton SA3480 and their effects on scales forming were studied. Gypton SA860N was found to be the most efficient scales inhibitor for the water samples taken from the two stations. Finally, this study provided methodological support for the responsible for building the conventional and nuclear power stations, aiding in the search for alternatives to prevent possible problems associated with the presence of microorganisms responsible for biocorrosion.

Keywords: Power Stations, Cooling systems, Sulphate reducing bacteria, Biocides, Scales inhibitors.

Introduction

Seawater usually used in cooling systems as a heat transfer medium and frequently also as the final point to reject heat into the atmosphere by evaporating inside cooling towers. Depending on the quality of available seawater supply, waterside problems develop in cooling water systems as a result of biological growth as: scaling, corrosion, dirt and dust accumulation. Any of these problems result in costly unscheduled downtime, reduced capacity, increased water usage, high operation and maintenance costs expensive parts replacements and acid cleaning

operations which reduce the life of the cooling system (Baraka *et al.*, 2008). According to recent investigations, damages due to corrosion in United States causes annual costs due to corrosion damage ranged from 1 to 5% of the gross national product (GNP) of each nation (Widdel and Cypionka, 2003). (Prabha *et al.*, 2014) said that corrosion costs the oil industry millions of dollars a year. Corrosion affects every aspect of exploration and production, from offshore rigs to casing, and reviews the role of corrosion agents such as drilling and production fluids. Studying the corrosion reveals that the microbiologically influenced corrosion (MIC) is a very dangerous process, this affects many industries (Pope and Morris, 1995). Microbiologically influenced corrosion (MIC) is problematic for the nuclear power

*Corresponding author: M. M. Abdelrahman
DOI: <https://doi.org/10.14741/ijcsb/v.4.1.1>

plants, paper-making and oil industry. Also it can cause considerable damages to water - cooling systems, sewage treatment facilities and underground pipes and ships. The complexity and the environmental dependence of bacterial activities make it difficult to estimate the probability of different processes.

Many types of bacteria including sulphate, iron and CO₂ reducing bacteria, sulphur, iron and manganese-oxidizing bacteria are associated with the MIC of metals and alloys (**Beech and Sunner, 2004; Anandkumar et al., 2009**). Among MIC, sulphate reducing bacteria sulfate reducing bacteria (SRB) are recognized as a major group involved in anaerobic corrosion. These latter microorganisms can coexist in naturally occurring biofilms with a wide bacterial community, including fermentative bacteria, often forming synergistic communities that are able to influence electrochemical processes through cooperative metabolism (**Beech and Gaylarde, 1999, Manafi et al., 2013 and Zhao et al., 2014**).

Microbial corrosion by SRB results in severe graphitization of cast iron, leaving a soft surface liable to collapse (**Seth and Edyvean, 2006**). SRB are capable of causing severe corrosion of iron material in a water system because they produce enzymes which have the power to accelerate the reduction of sulphate compounds to the corrosive hydrogen sulphide, thus SRB act as a catalyst in the reduction reaction. A water system may naturally contain sulphate based compounds (**Manafi et al., 2013**). The activities of SRB in natural and man-made systems are of great concern to engineers in many different industrial operations (**Gibson, 1990; Odom and Singleton, 1992**). Considerable efforts have been directed toward controlling SRB growth and inhibition of microbial induced corrosion (**Gavrilă, et al., 2003**). Inhibition of corrosion is the slowdown of the corrosion rate by using substances which when added in small amounts, they decrease the rate of attack by these bacteria on a metal (**Ash and Ash, 2001**). A number of methods for controlling SRB sulfide production in different industrial facilities including the use of biocides (**Gardner and Stewart, 2002**). Consequently, considerable researches have been devoted to testing various potential micro biocides (**Kumaraswamy et al., 2010**). Biocides treatments are widely used to decrease biofouling and MIC in steel pipes and in closed systems. The use of corrosion inhibitors to prevent metal dissolution will be inevitable. Corrosion inhibition efficiency of organic compounds is related to their adsorption properties (**Okafor and Zheng, 2009**). The adsorption of these molecules depends mainly on certain physicochemical properties of the inhibitor molecule such as the presence of heteroatoms including: oxygen, sulfur, nitrogen and phosphorus atoms and multiple bonds in the molecule through which they are adsorbed on the metal surface (**Shaban, et al., 2013**). In this study we try to investigate methods for evaluation and controlling the most important economic problems resulted from the

presence of some microorganisms are known to promote corrosion of metals and/or their mixtures (alloys) in cooling water systems in the different Egyptian industrial fields like power stations, oil fields and also power plants, such corrosion is typed as microbiologically influenced corrosion (MIC). Also, the study aims to find applicable treatment methods for controlling sulphate reducing bacteria (SRB) as one of the important members of microbiologically induced corrosion (MIC) in seawater used in cooling systems of Abu-Qir and Ataka power stations, through reducing the growth and activities, consequently reduce the harmful impact of its presence in different industries as we mentioned before.

Materials and Methods

Sampling preparations for detection and enumeration of Sulphate Reducing Bacteria (SRB)

The study was conducted on a conventional water cooling systems of Abu-Qir steam power station located at Alexandria on the coast of the Mediterranean Sea and Ataka thermal power station which located south west of Suez city on the coast of the Gulf (Suez), Egypt. The water samples were collected from both power stations at different points; the inlet, outlet lines and cooling condensers. Samples stored in sterile polypropylene bottles under anaerobic conditions of nitrogen gas filling, then stored in ice tank upon analysis. A liquid Starkey growth medium media (**Starkey, 1948**) used in test methods cover the procedure for the detection and enumeration by the most probable number (MPN) technique for sulphate reducing bacteria in water or water-formed deposits. The contents was dissolved in 1000 ml. of pre-boiled Mediterranean Sea water used in Abu- Qir power station cooling system, pH was adjusted at 7.3, then dispensed at a rate of 9.0 ml broth media per pre-washed and sterilized glass vials, undergo an anaerobic conditions through filling it well with nitrogen gas and then tightly closed with rubber stopper and capped with aluminum caps, autoclaved at 121°C for 15 minutes. After sterilization, the bottles were classified into sets; each set for one sampling point (inlet, outlet, condensers and sea outlet). We made those sets to apply serial dilution up to 10⁻⁶ fold dilution for each point. Finally, samples incubated at 33°C for 21 days. Recording blacking of vial or the black precipitate (sulphide production) indicate the positively presence of sulphate reducing bacteria which are widely distributed in marine and fresh water due to its production through these organisms during dissimilation of sulphate reduction through an incubation period of three weeks. The same steps were repeated for red sea water used in Ataka power station's cooling system. The Enumeration of SRB in all experiments was done using the Most Probable Number (MPN) technique according to (**ASTM designation: D4412-84, 1990**) and (**Videla, 1996**). The MPN count of SRB was compared with the

statistical table of Cochran (Cochran, 1950). Differences were considered significant at the 95% confidence interval.

Evaluation of different biocides efficiency on controlling SRB growth

Three different biocides obtained from the Egyptian Petroleum Research Institute: type A (*Aldhydic form*) and type B (*Amine form*) with commercial names **Champion (A, B), E.C.C. (A, B) and EPRI (A, B)** were studied. Each biocide was added to a sterilized anaerobic vial containing 100 ml of Sea water sample to reach a final desired concentration of 100 ppm. This step was done to obtain different concentrations (100, 200, 300, 400, 500 and 600ppm) from each biocide used. A vial with the same anaerobic conditions must be left untreated to represent the control vial. In addition, each biocide was kept in contact with seawater containing SRB for two hours at 30°C. At the end of contact time and by using a sterilized syringe, 1ml of each concentration was inoculated into a Starkey modified medium, incubated at 33°C for three weeks. Enumeration of SRB took place and MPN values were calculated. This experiment was repeated for the cooling Seawater of both stations under study.

Scales formation and scales inhibitors

Solubility of common seawater scales

According to (Amer B.M. and Abu Azam M.Y., 2009) for each experiment of common seawater scales, 100ml of each filtered opposite waters was poured into beaker. The mixture heated on hot plate with continuous stirring by magnetic stirrer then the mixture was filtered through 0.45 µm. After filtration, 5ml of the filtrate was pipetted into a 50ml volumetric flask and filled up with distilled water to 50 ml. This instantaneous dilution of the CaCO₃, CaSO₃ and SrSO₄ containing seawater just after filtration was performed in order to prevent their precipitations during the period between filtering and analytical determination of the Ca, Ba and Sr concentrations. The calcium and strontium determinations were calibrated by measuring five standard solutions. Standard solutions were prepared from CaCl₂, SrCl₂. Calcium and strontium concentrations in the diluted filtrates were determined by atomic absorption spectrometry. After multiplying with the dilution factor, the exact concentrations of calcium and strontium were computed.

Evaluation of the efficiency of some scale inhibitors on scales formation in water cooling systems

Three different scale inhibitors have commercial names (*Gypton SA860N, Gypton SD132 and Gypton SA3480*) obtained from the Egyptian Petroleum Research Institute were evaluated. Different concentrations of each Gypton type were prepared separately; each one was added to a cell test containing

50 ml. of the sulphate containing seawater sample to reach final desired concentrations: 5, 10, 15, 20 and 25 ppm. A blank were prepared by adding 50 ml of sulphate containing seawater sample to the test cell alone without adding any of scales inhibitors. All test cells were capped well and agitate to mix them thoroughly (**NACE Standard T1A0374-90, Item No. 5302, 3 1990**). All test cells and blanks immerse to 3/4 of their lengths in a water bath at 160°F (71°C) for 24 hours. The test cells removed after the 24 hour exposure and avoid agitation. The test cells cool to 77°F (25°C) and 9°F (5°C) for a time not to exceed two hours. Pipiting 1.0 ml of the test sample to a suitable vial, avoiding transfer of calcium sulfate crystals and dilute with distilled water, deionized water. The calcium ion concentrations were determined by procedures given in **ASTM D 511-88 (2004)**.

Evaluating study of the effect of the presence of both biocides and scales inhibitors on SRB growth

Gypton SA860N was selected as the most effective scales inhibitor that gave the best results in scales inhibition. A solution with a final concentration 10 ppm was prepared in 100 ml of seawater sample present in a sterilized anaerobic vial. This step was prepared before adding the desired biocide by 24 hours (Champion A was chosen due to its high efficiency between all biocides under investigations in controlling SRB growth). Champion A was prepared to achieve the concentration of 100 ppm and was added to the vial. This step was repeated to obtain several concentrations of Champion A (100, 200, 300, 400 and 500 ppm) with a constant (Gypton SA860N) concentration of 10 ppm. Then the same steps that achieved for evaluation of biocides repeated, log counts of SRB were calculated. Results were recorded for cooling seawater of both power stations under investigations.

Results and Discussion

Detection and enumeration of SRB in water cooling systems of Abu-Qir and Ataka power stations

In this experiment, samples were collected from different points of water cooling systems lines of both Abu-Qir and Ataka power stations in order to detect and enumerate sulphate reducing bacteria (SRB) and consequently to handle the problems they cause. The counts at sea water inlet, outlet, station outlet and the three condensers are given in Table (1).

Results showed that SRB counts differ from point to point, but it was noticed that these counts in Ataka power station water cooling system (Gulf (Suez)) were generally greater than that of Abu-Qir power station water cooling systems (Mediterranean Sea). These results may be remarked that there were appropriate conditions for sulphate reducing bacterial growth among the cooling water systems which support SRB prosperous.

Table (1): Sulphate reducing bacterial counts of Abu-Qir and Ataka stations

Sample Number	Sample Sitting	Sulfate reducing bacteria count (cell/ml)	
		Abu-Qir (Alex.)	Ataka (Suez)
Sample A	Condenser 1	2.4×10^5	2.6×10^5
Sample B	Condenser 2	7.5×10^4	9.8×10^4
Sample C	Sea Water Inlet	7.6×10^5	9.4×10^5
Sample E	Condenser 3	1.1×10^5	1.4×10^5
Sample O	Station Outlet	1.5×10^5	1.9×10^5
Sample D	Sea Water Outlet	0.6×10^5	0.8×10^5

Table (2): Sulphate reducing bacteria counts and Champion biocide efficiency change (%)

Biocide Conc., ppm	Champion Biocide							
	Abu-Qir (Alexandria)				Ataka (Suez)			
	Type A		Type B		Type A		Type B	
	Log Count	Efficiency %	Log Count	Efficiency %	Log Count	Efficiency %	Log Count	Efficiency %
Control	5.75	0.00	5.75	0.00	5.90	0.00	5.90	0.00
100	3.85	33.04	4.65	19.13	4.55	22.88	4.75	19.49
200	2.56	55.48	3.82	33.57	3.02	48.81	4.12	30.16
300	2.12	63.13	2.81	51.13	2.45	58.47	3.11	47.28
400	1.30	77.39	1.56	72.87	1.50	74.57	1.83	68.98
500	0.00	100	1.20	79.13	0.00	100	1.36	76.94
600	0.00	100	0.00	100	0.00	100	0.00	100


This data absolutely helped in selecting the most effective biocides and its Minimum inhibitory concentrations, the fact that agree with **(Brözel and Cloete 1993)** who stated that, the minimum inhibitory concentration of different biocides required for a specific killing percentage against a particular organism (biocide fingerprint) can be determined only once the microbial population structure in a system is known. Also enumerating the initial counts will help in pre-determination of the contact time required for a biocide to kill SRB in different sea water samples in all target points.

Effect of different concentrations of Champion biocide with its two types (A and B) on SRB growth

Table (2) and Figure (1,2) summarized the data obtained as a result of applying Champion with its two types A and B and their efficiency percentage on reducing the log count of SRB present in cooling systems for both station under investigations. Generally it was concluded from the obtained data that as the concentration of Champion A or B increased, the log counts decreased and the efficiency changes increased for both types. The data marked that Champion A more efficient than Champion B and that for samples of both stations. Also 500 ppm of Champion A were sufficient for completely inhibit SRB growth effectively by 100 % and that for the two stations. At the same conditions, 600 ppm of Champion B was destroyed SRB growth in both water samples

completely. So, it was concluded that the aldehydic biocide champion A was clearly more effective than the amine form (Champion B) as an inhibitor for SRB growth.

This data agrees with what has been achieved by other studies. **(Von Reg and Sand, 1998)** evaluated different biocides efficacy for SRB treatment. The samples were treated with the biocide formaldehyde, tetra methyl ammonium hydroxide, 1,8 di hydroxy anthrax quinone and a commercial biocide named Dilurt at different concentrations. It was found that formaldehyde exhibited the best effect. Only 3% of the original microbial activity remained and reduction in SRB cell numbers of five orders of magnitude.

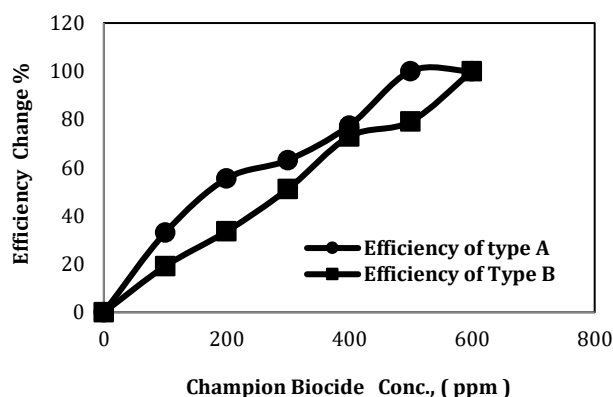**Fig (1):** Comparison between efficiency of Champion A and B types for Abu-Qir station

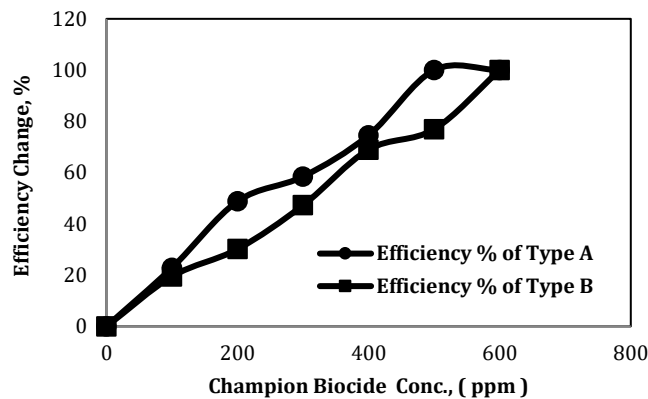


Fig (2): Comparison between the efficiency of Champion A and B types for Ataka station

Table (3): Sulphate reducing bacteria log counts and efficiency change % of biocide E.C.C.

Biocide Conc., ppm	E.C.C. Biocide							
	Abu-Qir (Alexandria)				Ataka (Suez)			
	Type A		Type B		Type A		Type B	
	Log Count	Efficiency %	Log Count	Efficiency %	Log Count	Efficiency %	Log Count	Efficiency %
Control	5.70	0.00	5.70	0.00	5.90	0.00	5.90	0.00
100	5.02	11.93	5.30	7.018	5.32	9.83	5.55	5.93
200	4.84	15.09	4.88	14.39	5.04	14.57	5.08	13.89
300	3.80	33.33	4.23	25.79	4.20	28.81	4.63	21.52
400	2.32	59.29	3.67	35.61	2.82	52.20	3.85	34.74
500	1.30	77.19	1.60	71.93	1.50	74.57	1.90	67.79
600	0.00	100	0.00	100	0.00	100	0.00	100

On the other hand, tetra methyl ammonium hydroxide had only a slight effect. Microbial activities were reduced only to 20% and the cell numbers did not decrease at all. Zakaria, et al., 2012 stated that the Aldhydic biocides were more effective than the amine type biocides for SRB inhibition.

Effect of different concentrations of E.C.C. biocide (A and B) type on SRB growth

The second biocide under investigation was E.C.C. with its two types Aldhydic type (A) and amine type (B). Table (3) and Fig (3,4) illustrated the data obtained from the relation between log counts of sulphate reducing bacterial and percentage of efficiency change of biocide E.C.C. type A and also for type B for both seawater samples of the two power stations. The data indicated that maximum log counts recorded in control sample and as the concentration of E.C.C. biocide increased the log bacterial counts decreased and the efficiency change increased. Also it was clear that the aldhycic form A was more efficient than the amine form B in inhibition of sulphate reducing bacteria in the samples of both power stations. This agrees with what has been achieved by Anna Turkiewicz, et al.(2013), Von Reg and Sand (1998), Gardner and Stewart (2002) and Zakaria, et al.,(2012). The results illustrated also, that by increasing the concentrations of ECC biocide, there were noticeable decreases in log

counts of SRB comparing with control and 600 ppm of E.C.C. (A and B) types lead to 100% inhibition of SRB counts in all samples.

Effect of different concentrations of E.P.R.I. (A and B) type on SRB growth

The study was conducting on two another types of selected biocide E.P.R.I. The Aldhydic form was type A and B is the amine form. Table (4) and Figs (5,6) summarized the obtained data of log counts of sulphate reducing bacteria and efficiency change percent of E.P.R.I. type A and type B for seawater sample of Abu-Qir and Ataka power stations. The data indicated that as the concentration of biocide increased from 100 to 600 ppm the bacterial counts decreased gradually comparing to the control. Also, the efficiency change increased with increasing the biocide concentrations and E.P.R.I. type A noticed to be more efficient than E.P.R.I. type B for the samples of two stations. The results agreed with Anna Turkiewicz, et al.(2013) and Zakaria, et al.,(2012) which marked to those Aldhydic biocides always more effective than amine formed ones.

Maximum inhibition dose of Biocide E.P.R.I. type A recorded at 600 ppm for the investigated samples of the two stations but for type B it was found that 600 ppm was not a sufficient concentration for growth inhibition of sulphate reducing bacterial counts for the

Table (4): Sulphate reducing bacteria log counts and efficiency change % of biocide E.P.R.I.

Biocide Conc., ppm	E.P.R.I. Biocide							
	Abu-Qir (Alexandria)				Ataka (Suez)			
	Type A		Type B		Type A		Type B	
	Log Count	Efficiency %	Log Count	Efficiency %	Log Count	Efficiency %	Log Count	Efficiency %
Control	5.70	0.00	5.70	0.00	5.90	0.00	5.90	0.00
100	5.38	5.61	5.57	2.28	5.56	5.76	5.88	0.33
200	4.54	20.35	5.12	10.18	5.45	7.62	5.42	8.13
300	3.20	43.86	4.60	19.29	4.00	32.20	4.90	16.94
400	1.71	70.00	4.12	27.72	1.91	67.62	4.52	23.38
500	1.00	82.46	3.20	43.86	1.40	76.27	3.12	47.11
600	0.00	100	1.80	68.42	0.00	100	1.90	67.79

two samples. That mean biocide E.P.R.I. type B was less effective than E.P.R.I. type A, since type B biocide reduced the log SRB counts than the control whereas biocide type A inhibit the growth completely. It must be emphasized that the concentration of a biocide is not related linearly to its activity; a concentration power is involved in the relationship.

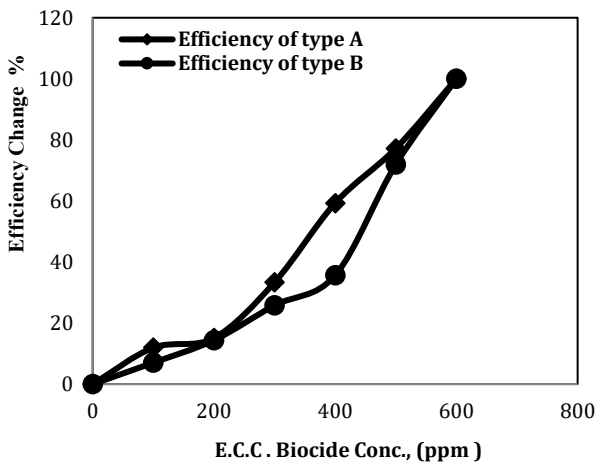


Fig (3): Comparison between efficiency of E.C.C.A and B types for Abu-Qir station

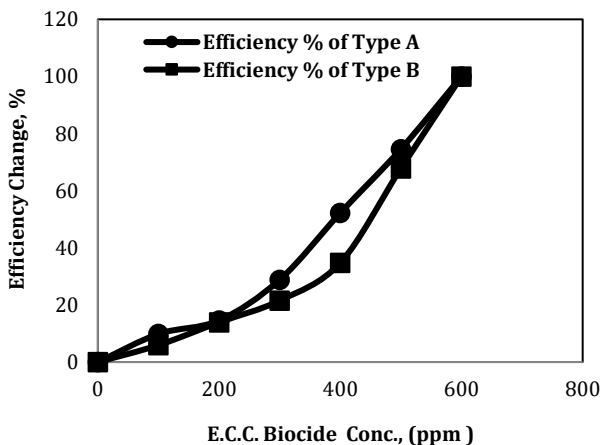


Fig (4): Comparison between efficiency of E.C.C. A and B types for Ataka station

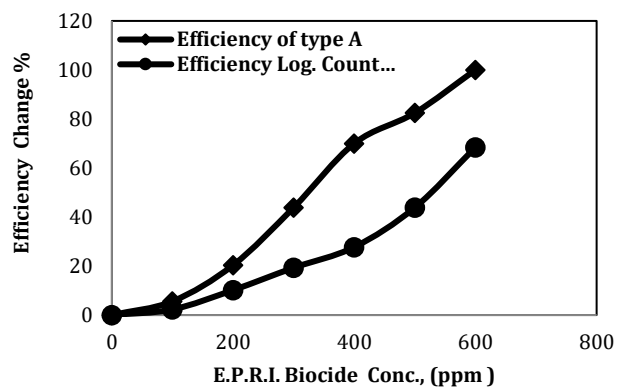


Fig (5): Comparison of efficiency of biocide E.P.R.I. A and B types for Abu-Qir station

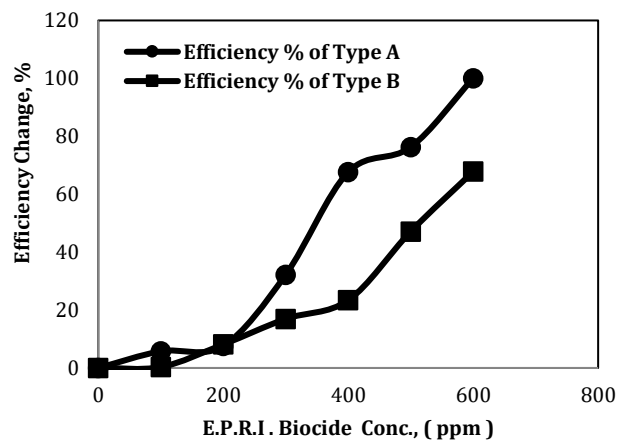


Fig (6): Comparison of efficiency of biocide E.P.R.I. A and B types for Ataka station

Using biocides to control sulphate reducing bacteria is acceptable and commonly used in practice. Although biocides are used to reduce bacterial counts, they do not necessarily reduce the fouling rates. It is essential to apply the correct biocide concentration at the correct frequency. Wrong use of biocides gives poor results and is expensive. For more effective biocide selection, a comparative study between the efficiency of the three aldehydic forms of the evaluated biocides and that for Abu-Qir and Ataka power stations sea

water samples as shown in Figs. (7,8). The results indicated that Champion A biocide was the more effective, the evaluated efficiency change sequence was as follow: **Champion A > E.P.R.I. A > E.C.C. A**. When comparing between the effects of the three amine forms of biocides concentrations under investigations and the efficiency change for Abu-Qir power station Sea water samples as represented in Figs. (9,10). The data indicated that Champion B is the most efficient amine form biocide and the evaluated efficiency change sequence was as follow: **Champion B > E.C.C. B > E.P.R.I. B**.

Finally from what has been mentioned, the results clarified that Aldehydic biocide Champion A is the most powerful biocide among the others that had been tested. As at all its concentrations, it exhibited the highest efficiency for reducing SRB log counts than others evaluated biocides. Also it recorded the lowest minimal inhibitory concentration for growth inhibition at the lowest concentrations. So it will be selected as the most efficient biocide among the others.

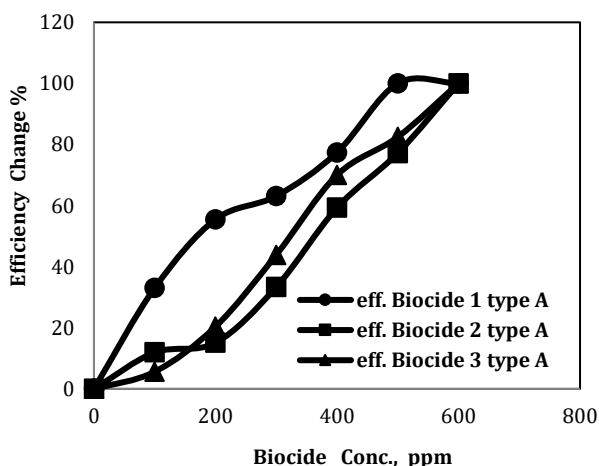


Fig (7): Comparative study of efficiency of three biocides A type for Abu-Qir station

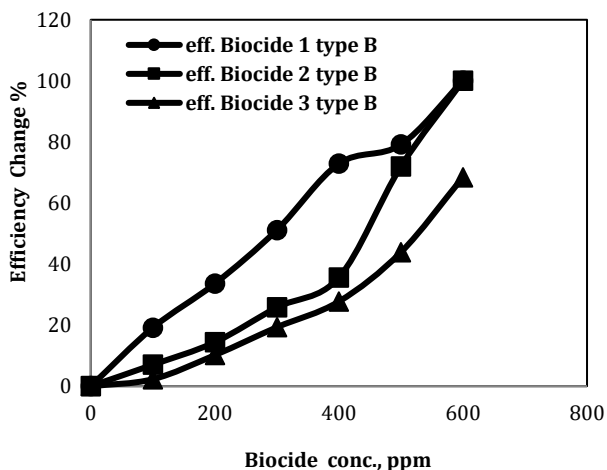


Fig (8): Comparative study of efficiency of three biocides B type for Abu-Qir station

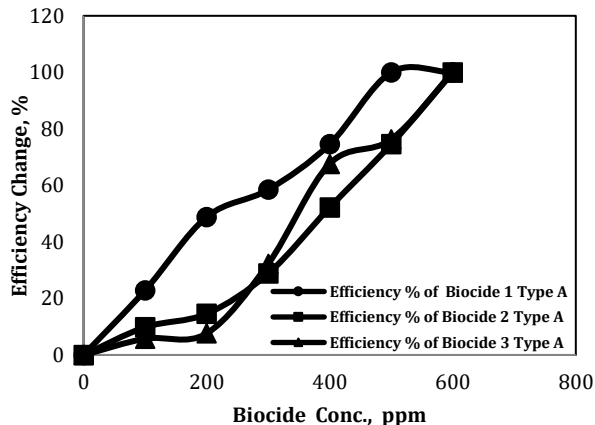


Fig (9): Comparative study of efficiency of three biocides A type for Ataka station

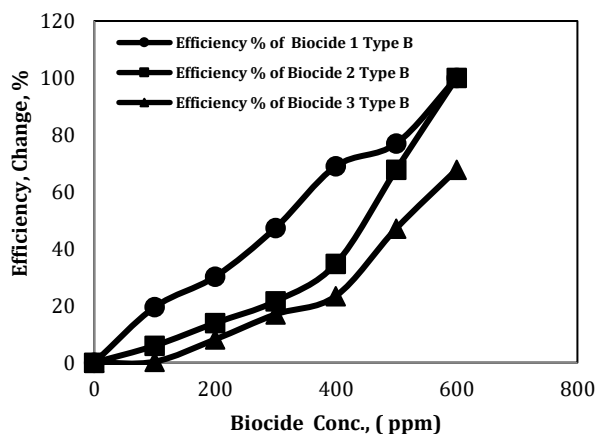


Fig (10): Comparative study of efficiency of three biocides B type for Ataka station

Scales formation and scales inhibitors

Seawater mostly contains alkaline earth metal cations such as magnesium, calcium, barium and anions such as carbonate, bicarbonate, sulfate, silicate, oxalate, phosphate, etc. This part of research is a trial to find an applicable method for prevention of biodeterioration of industrial materials, thereby preserving their structures and prolong their usage as long as possible so as to reduce the costs which is very important gigantic industrial projects, like nuclear power plants and oil industries. Deterioration may be a result of scales formation and also biofilm formation results from SRB activities.

Solubility analyses of common scales forming salts in Mediterranean and Gulf (Suez) seawater were summarized in Tables (5,6) and Fig. (11,12). Results show that the relation between the concentrations of the common salts CaCO₃, CaSO₄ and SrSO₄ change at different temperatures. The data indicated that by increasing the temperature the solubility of CaCO₃, CaSO₄ and SrSO₄ decreased at various temperatures. The expected trend in this temperature range is a decrease of CaSO₄ and SrSO₄ solubility's with increasing temperature.

Table (5): Solubility of scales in Mediterranean seawater

Temp. °C	Temp. °F	CaCO ₃ , mg/L	CaSO ₄ , mg/L	SrSO ₄ , mg/L
25	77	3019.25	4283.74	492.24
50	122	1876.63	2113.52	241.51
100	212	998.08	1214.91	145.58
150	302	830.12	530.07	87.44
200	392	770.33	140.53	66.65

Table (6): Solubility of scales in Gulf (Suez) seawater

Temp. °C	Temp. °F	CaCO ₃ , mg/L	CaSO ₄ , mg/L	SrSO ₄ , mg/L
25	77	3019.25	4283.74	492.24
50	122	1876.63	2113.52	241.51
100	212	998.08	1214.91	145.58
150	302	830.12	530.07	87.44
200	392	770.33	140.53	66.65

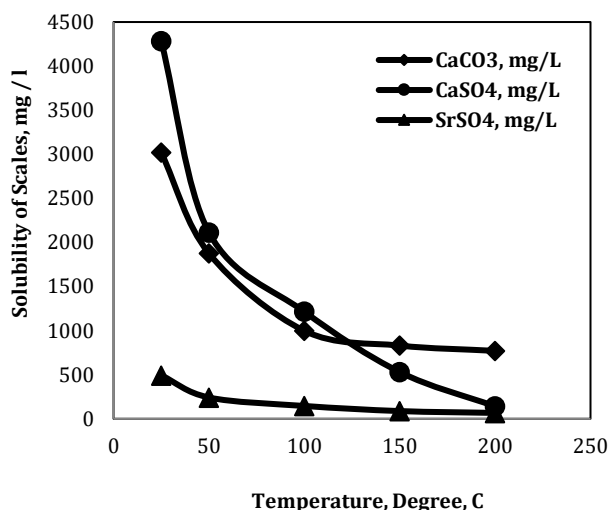


Fig (11): Solubility of common scales in Mediterranean seawater

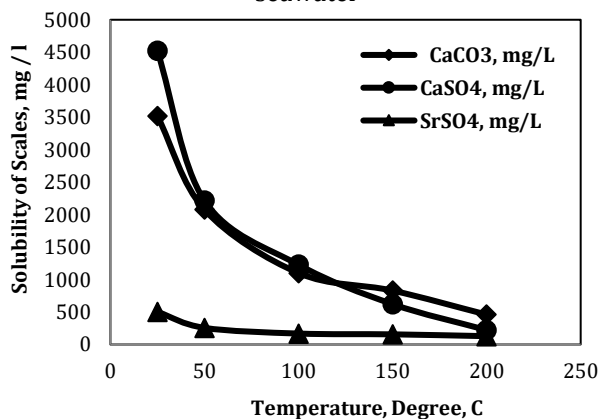


Fig (12): Solubility of common scales in Gulf (Suez) seawater

The solubility of CaSO₄ and SrSO₄ decrease with increasing temperature because of dissociation of

CaSO₄ and SrSO₄ which are exothermic reaction so, the deposition of the common scales increased by increasing temperature reached maximum at 200°C. Three types of scales inhibitors with commercial names *Gyptron SA860N*, *Gyptron SA3480* and *Gyptron SD132* were studied to evaluate their efficiency. Generally the scales inhibitors are chemically based on three types of compounds, phosphate esters, phosphonates and polymers. Previous studies indicated that the polymeric based scales inhibitors are particularly preferred, that they can be made by any conventional polymerization method of an anionic monomer that carrying a group (may be carboxylic group) capable of providing a negative charge on the resulting polymeric chain. The scales inhibitors are always commercially available.

Evaluation of some scales inhibitors on scales formation in water cooling systems of Abu-Qir and Ataka power stations

The effect of different concentrations of three types of scales inhibitors on the scales formed in Sea water samples of Abu-Qir (Alexandria) station and Ataka (Suez) station summarized in Tables (7,8). Figs. (13,14) is a comparison study between the efficiency of the three types of the scale inhibitors. The results indicated that *Gyptron SA860N* is the most significant scale inhibitor between the three types tested. Their efficiency is taking the order: *Gyptron SA860N* > *Gyptron SA3480* > *Gyptron SD132*. Scales inhibitors such as phosphonates or polyacrylic acid, show very strong inhibitory effects to prevent mineral scales formation in the oil and gas production system. It has been observed that many aspects of the brine composition and operation condition may affect the performance of the inhibitors. An understanding of the inhibition mechanism is needed in order to predict how these operational variations affect inhibition.

Table (7): The effect of scales inhibitors concentrations on scale forming for Abu-Qir station

Scale Inhibitor Dose, ppm	Gypton SA860N		Gypton SD132		Gypton SA3480	
	Scale formed	Efficiency	Scale formed	Efficiency	Scale formed	Efficiency
0.0	12692.3	0.00	12692.3	0.00	12692.3	0.00
5.0	10737.69	15.4	11346.92	10.59	11143.84	12.19
10.0	8839.226	30.35	10699.61	15.69	9529.226	24.92
15.0	7508.995	40.84	10014.22	21.1	8328.841	34.37
20.0	7410.687	41.61	10006.92	21.16	8237.76	35.09
25.0	7405.3	41.65	9998.97	21.22	8126.38	35.97

Table (8): The effect of scales inhibitors concentration on scale forming for Ataka(Suez) station

Scale Inhibitor Dose, ppm	Gypton SA860N		Gypton SD132		Gypton SA3480	
	Scale formed	Efficiency	Scale formed	Efficiency	Scale formed	Efficiency
0.00	1606.65	0.00	1606.65	0.00	1606.65	0.00
5.00	1346.37	16.20	1400.99	12.80	1386.53	13.70
10.0	1193.74	25.70	1322.27	17.70	1245.92	22.45
15.0	1041.11	35.19	1229.08	23.50	1143.93	28.80
20.0	1040.74	35.22	1227.14	23.62	1135.51	29.32
25.0	1039.86	35.27	1226.97	23.63	1133.90	29.42

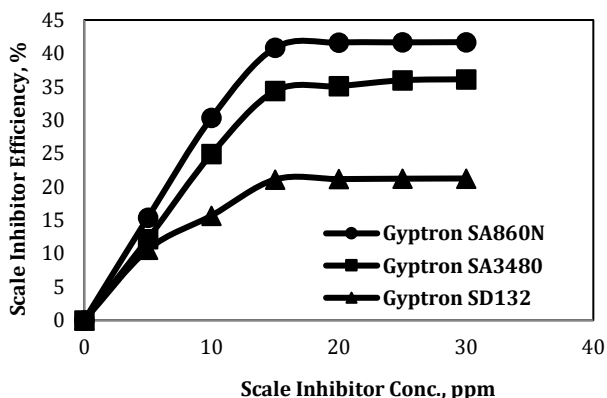


Fig (13): The effect of scale inhibitors concentrations on scale forming for Abu-Qir station

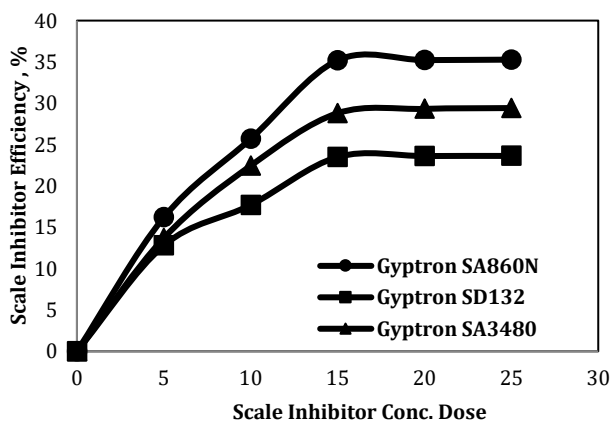


Fig (14): The effect of scale inhibitors concentrations on scale forming for Ataka (Suez) station

The effect of the most efficient scales inhibitors Gypton SA860N on biocides efficiency and consequently, to SRB counts

Corrosion, scaling and biofouling, three fetal problems that affect the performance of the recirculation cooling water system, an important component in most industries. Most of the industries are adding biocides and scales inhibitors at the same place in cooling water systems. Inhibitors are added continuously and biocides may added once weekly or once in fifteen days. The inhibition efficiency increases with circulation velocity rise and resisted to immersion time. Moreover, the inhibition efficiency was circa temperature-independent and retained its performance on a surface covered by corrosion products and though in very aggressive media such as 3% NaCl. The study explored the influence of the presence of the most efficient scales inhibitors, as indicated from the results, Gypton SA860N on the log SRB counts in the presence or absence of the most effective biocides independently Champion (A,B) as represented in Table (9) and Figs (15-18). The data reflected that, as the concentration of biocide increased SRB growth decreased in presence or absence of the scales inhibitor but in the presence of scales inhibitor the efficiency of the two biocides decreased and Champion A more effective than Champion B in presence or absence of (Gypton SA860N). This result parallel to what has been achieved by **Maruthamthu, et al.,(2000)**, they used Morpholine phosphate as biocide and they stated that, Morpholine phosphate when used alone acts as a good biocide, but when

Table (9): Effect of Gyptron SA860N on biocides efficiency and SRB log counts

Biocide Conc., ppm	Log Sulphate Reducing Bacteria count							
	Abu-Qir (Alexandria)				Ataka (Suez)			
	Without Gyptron SA860N		With 10 ppm Gyptron SA860N		Without Gyptron SA860N		With 10 ppm Gyptron SA860N	
	Champion A	Champion B	Champion A	Champion B	Champion A	Champion B	Champion A	Champion B
Control	5.8	5.8	5.8	5.8	5.93	5.93	5.93	5.93
100	4.3	4.6	5.23	5.45	4.46	5.36	5.13	5.82
200	2.5	3.47	3.31	4.42	2.78	4.57	3.87	4.75
300	1.6	2.4	2.2	2.98	2.54	2.83	2.8	3.28
400	1.08	1.51	1.94	2.58	2.33	2.56	2.62	2.84
500	0.00	1.2	0.00	1.62	0.00	1.36	0.00	1.75
600	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

combined with scale inhibitors, the killing efficiency was nil. Results suggest that bacteria should be killed first and inhibitors should be added later for getting higher efficiency and for avoiding the interference between biocides and scale inhibitors. An interaction process might occur among the scales inhibitors and biocide when added together to the seawater cooling system. The synergistic or combined effect of adding these chemicals to the seawater system might affect their effectiveness in maintaining the water quality of the system.

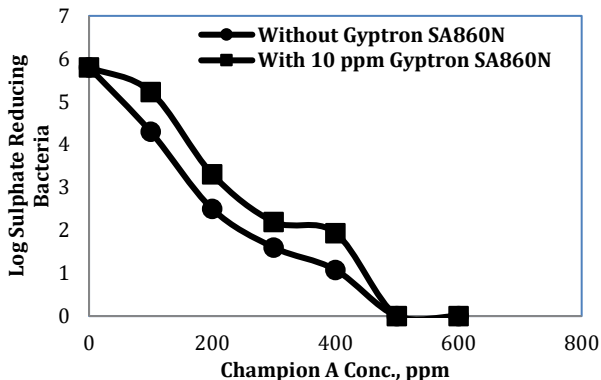


Fig (15): The effect of Champion A biocide on SRB counts with and without Gyptron SA860N scale inhibitor for Abu-Qir station

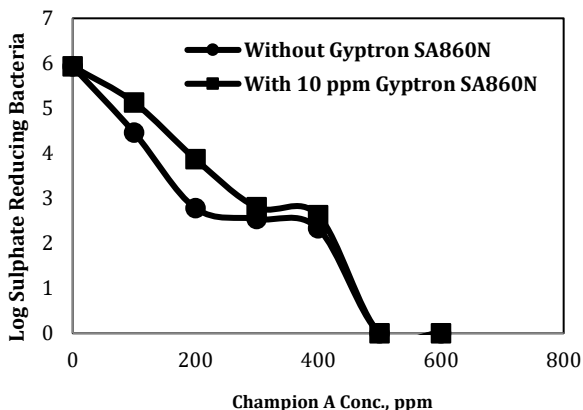


Fig (16): The effect of Champion A biocide on SRB log counts with and without GyptronA860N scales inhibitor for Ataka station

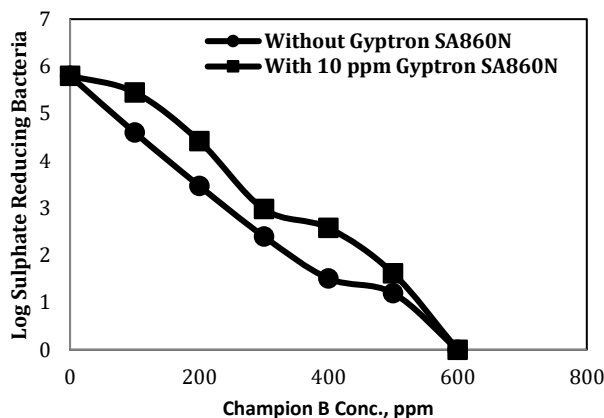


Fig (17): The effect of Champion B biocide on SRB log counts with and without Gyptron SA860N scales inhibitor for Abu-Qir station

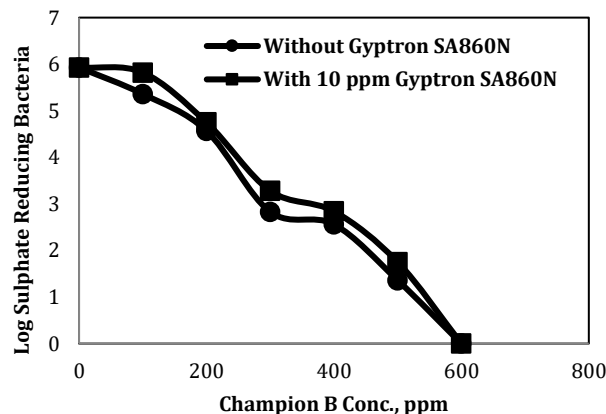


Fig (18): The effect of Champion B biocide on SRB log counts with and without Gyptron SA860N scales inhibitor for Ataka station

Conclusion

This study investigated detection and controlling of sulphate reducing bacteria (SRB) in cooling systems of Abu-Qir and Ataka power stations. The results indicated that the Aldhydic biocide *Champion A* was the most effective biocide of all investigated types for controlling SRB in samples collected from Abu-Qir and Ataka power stations. As the concentrations of biocide

increased, SRB growth decreased in presence or absence of Gypton SA860N. The early detection of SRB could be employed for preventing the damages on metal surfaces before the installation of corrosion processes. Strategies for reducing the time spent on SRB isolation and identification could be auxiliary tools for controlling the corrosion of materials. This study provided methodological support for those who are responsible for building the conventional and nuclear power stations, aiding in the search for alternatives to prevent possible problems associated with the presence of microorganisms responsible for biocorrosion. Although corrosion is a natural process, the presence of SRB accelerates the corrosion rate; therefore, alternatives to prevent and detect the potential problems could be employed in attempt to reduce the economic losses.

References

- Anandkumar B., Rajasekar A., Venkatachari G. and Maruthamuthu S., (2009):Effect of thermophilic sulphate-reducing bacteria isolated from Indian petroleum refinery on the corrosion of mild steel *Current Sci.* Vol. 97(3) pp:342-348.
- ASTM, D4412-84, (1990):Standard test methods for sulfate-reducing bacteria in water and water formed deposits Annual Book of ASTM standards, American Society for Testing and Materials, Vol. 11 .01.
- ASTM, D511-88, (2004):Corrosion tests and standards application and interpretation Robert Baboian Editor, ASTM International.
- Ash M. and Ash D. (2001):Handbook of corrosion inhibitors NACE International, Houston.
- Anna Turkiewicz, Joanna Brzeszcz, Piotr Kapusta, (2013): Oil & Gas Institute, Krakow The application of biocides in the oil and gas industry NAFTA-GAZ, Nr 2/2013, pp: 104- 111, Lusty.
- Beech I. and Sunner J., (2004):Biocorrosion towards understanding interactions between biofilms and metals *Curr. Opin. Biotechnol.* Vol.15 pp:181-186.
- Beech I. and Gaylarde C., (1999):Recent advances in the study of biocorrosion - an overview. *Rev. Microbiol.* Vol. 30 pp:177-190.
- Baraka-Lokmane S., K.S. Sorbie, N. Poisson and P. Lecocq, (2008): International Symposium of the Society of Core Analysts held in Abu Dhabi, UAE, SCA2008-05, 29 Oct. - 2 Nov.
- Brözler V. and Cloete T., (1993):Bacterial resistance to conventional water treatment biocides. *CAB Biodeterioration Abstracts* Vol.7pp: 387-395.
- Cochrane W., (1950):Estimation of bacterial densities by means of the most probable number. *Biometrics* Vol. 6 pp: 105.
- Gibson G., (1990):Physiology and ecology of the sulfate reducing bacteria. *J. Appl. Bacteriol.* Vol. 69 pp:769-797.
- Gardner L. and Stewart P., (2002):Action of glutaraldehyde and nitrite against sulfate reducing bacterial biofilms. *Ind. Microbiol. Biotechnol.* Vol. 29 pp: 354.
- Gavrilă L., D. Gavrilă and A. Simion, (2003):Microbiologically induced corrosion and its mitigation in cooling cycles, *Scientific Study and Research*, V. (IV) pp:1-2.
- Kumaraswamy R., Ebert S., Gray M., Fedorak P. and Foght J., (2010): Molecular- and cultivation-based analyses of microbial communities in oil field water and in microcosms amended with nitrate to control H₂S production. *Appl. Microbial Biotechnol.* DOI: 10.1007/s00253-010-2974-2978.
- Maruthamthi S., S. Pomariappa, KR. Indirli, A. Subramanian and N. Sreigawamy, (2000):Interference between biocides and inhibitors in cooling water systems *Bulletin of Electrochemistry* Vol. 16 (5) pp: 209-213.
- Manafi Z., M. Hashemi, H. Abdollahi and Gregory. J. Olson, (2013):Bio-corrosion of water pipeline by sulphate-reducing bacteria in a mining environment *African Journal of Biotechnology*, Vol. 12(46) pp: 6504-6516.
- NACE Standard T1A0374-90, Item No. 53023, (1990):Standard test method laboratory screening tests to determine the ability of scale inhibitors to prevent the precipitation of calcium sulfate and calcium carbonate from Solution National Association of Corrosion Engineers.
- Odom J. and Singleton R., (1992):The sulfate-reducing bacteria: contemporary perspective New York Springer-Verlag.
- Okafor P. and Y. Zheng, (2009)*Corrosion Science* Vol. 51 pp: 850.
- Prabha S., R. Rathish, R. Dorothy, G. Brindha, M. Pandiarajan, A. Al-Hashem and S. Rajendran, (2014):Corrosion problems in petroleum industry and their solutions *Eur. Chem. Bull* Vol. 3(3) pp: 300-307.
- Pope and D.H. Morris E. III. (1995):*Materials Performance* pp: 23
- Seth A. and R. Edyvean, (2006):The function of sulfate-reducing bacteria in corrosion of potable water mains. *Int. Biodeter. Biodegrad.* Vol. 58, pp: 108-111.
- Starkey R. (1948):Characterization and cultivation of sulphate-reducing bacteria American Water Works Association Vol. 40, pp: 1291.
- Shaban S., A. Saied, S. Tawfik, A. Abd-Elaal and I. Aiad, (2013):Corrosion inhibition and Biocidal effect of some cationic surfactants based on Schiff base *J. of Industrial and Engineering Chemistry*, Vol. 19, 2004-2009
- Von-Reg H. and Sand W. (1998):Evaluation of biocide efficacy by microcalorimetric determination of microbial activity in biofilms *J. Microbiol. Methods*, Vol. 33, pp: 227.
- Videla H.A. (1996):*Corrosion inhibition in the presence of microbial corrosion*. Paper No. 223, Corrosion 96, NACE International, Houston, TX.
- Widdel F. and Cypionka H. (2003):Microbiological study of the anaerobic corrosion of iron pp: 4, 27. Tag des promotionskolloquiums.
- Zakaria A.E., H. M. Gebreil and Naglaa M. Abdelaal, (2012):Control of Microbiologically Induced Corrosion in Petroleum Industry Using Various Preventive Strategies, *Arab Journal of Nuclear Sciences and Applications*, Vol.45 (2), pp:460-478.
- Zhao X., W. Fan, J. Duan and B. Hou, (2014):Microscopic studies on formation of corrosion product layer on steel exposed to simulated seawater influenced by sulfate-reducing bacteria, *J. of Chemical and Pharmaceutical Research*, Vol. 6 (1), pp: 465-469.
- Amer B.M., Abu Azam M. Y.(2009): Solubility of common oil field scales of injection water and high barium concentration and high salinity formation water *Journal Teknologi*, 50(F) Jun 2009: 67-77, University Teknologi Malaysia.